


Conditioned Suspended Concrete Floor
 Floor Covering and Underlayment
 Poured Subfloor w/ Radiant Tubes
 Wood Sub Floor
 2" Air Gap
 Insulation (R12 min) w/ optional Reflective Foil
 Drywall Ceiling

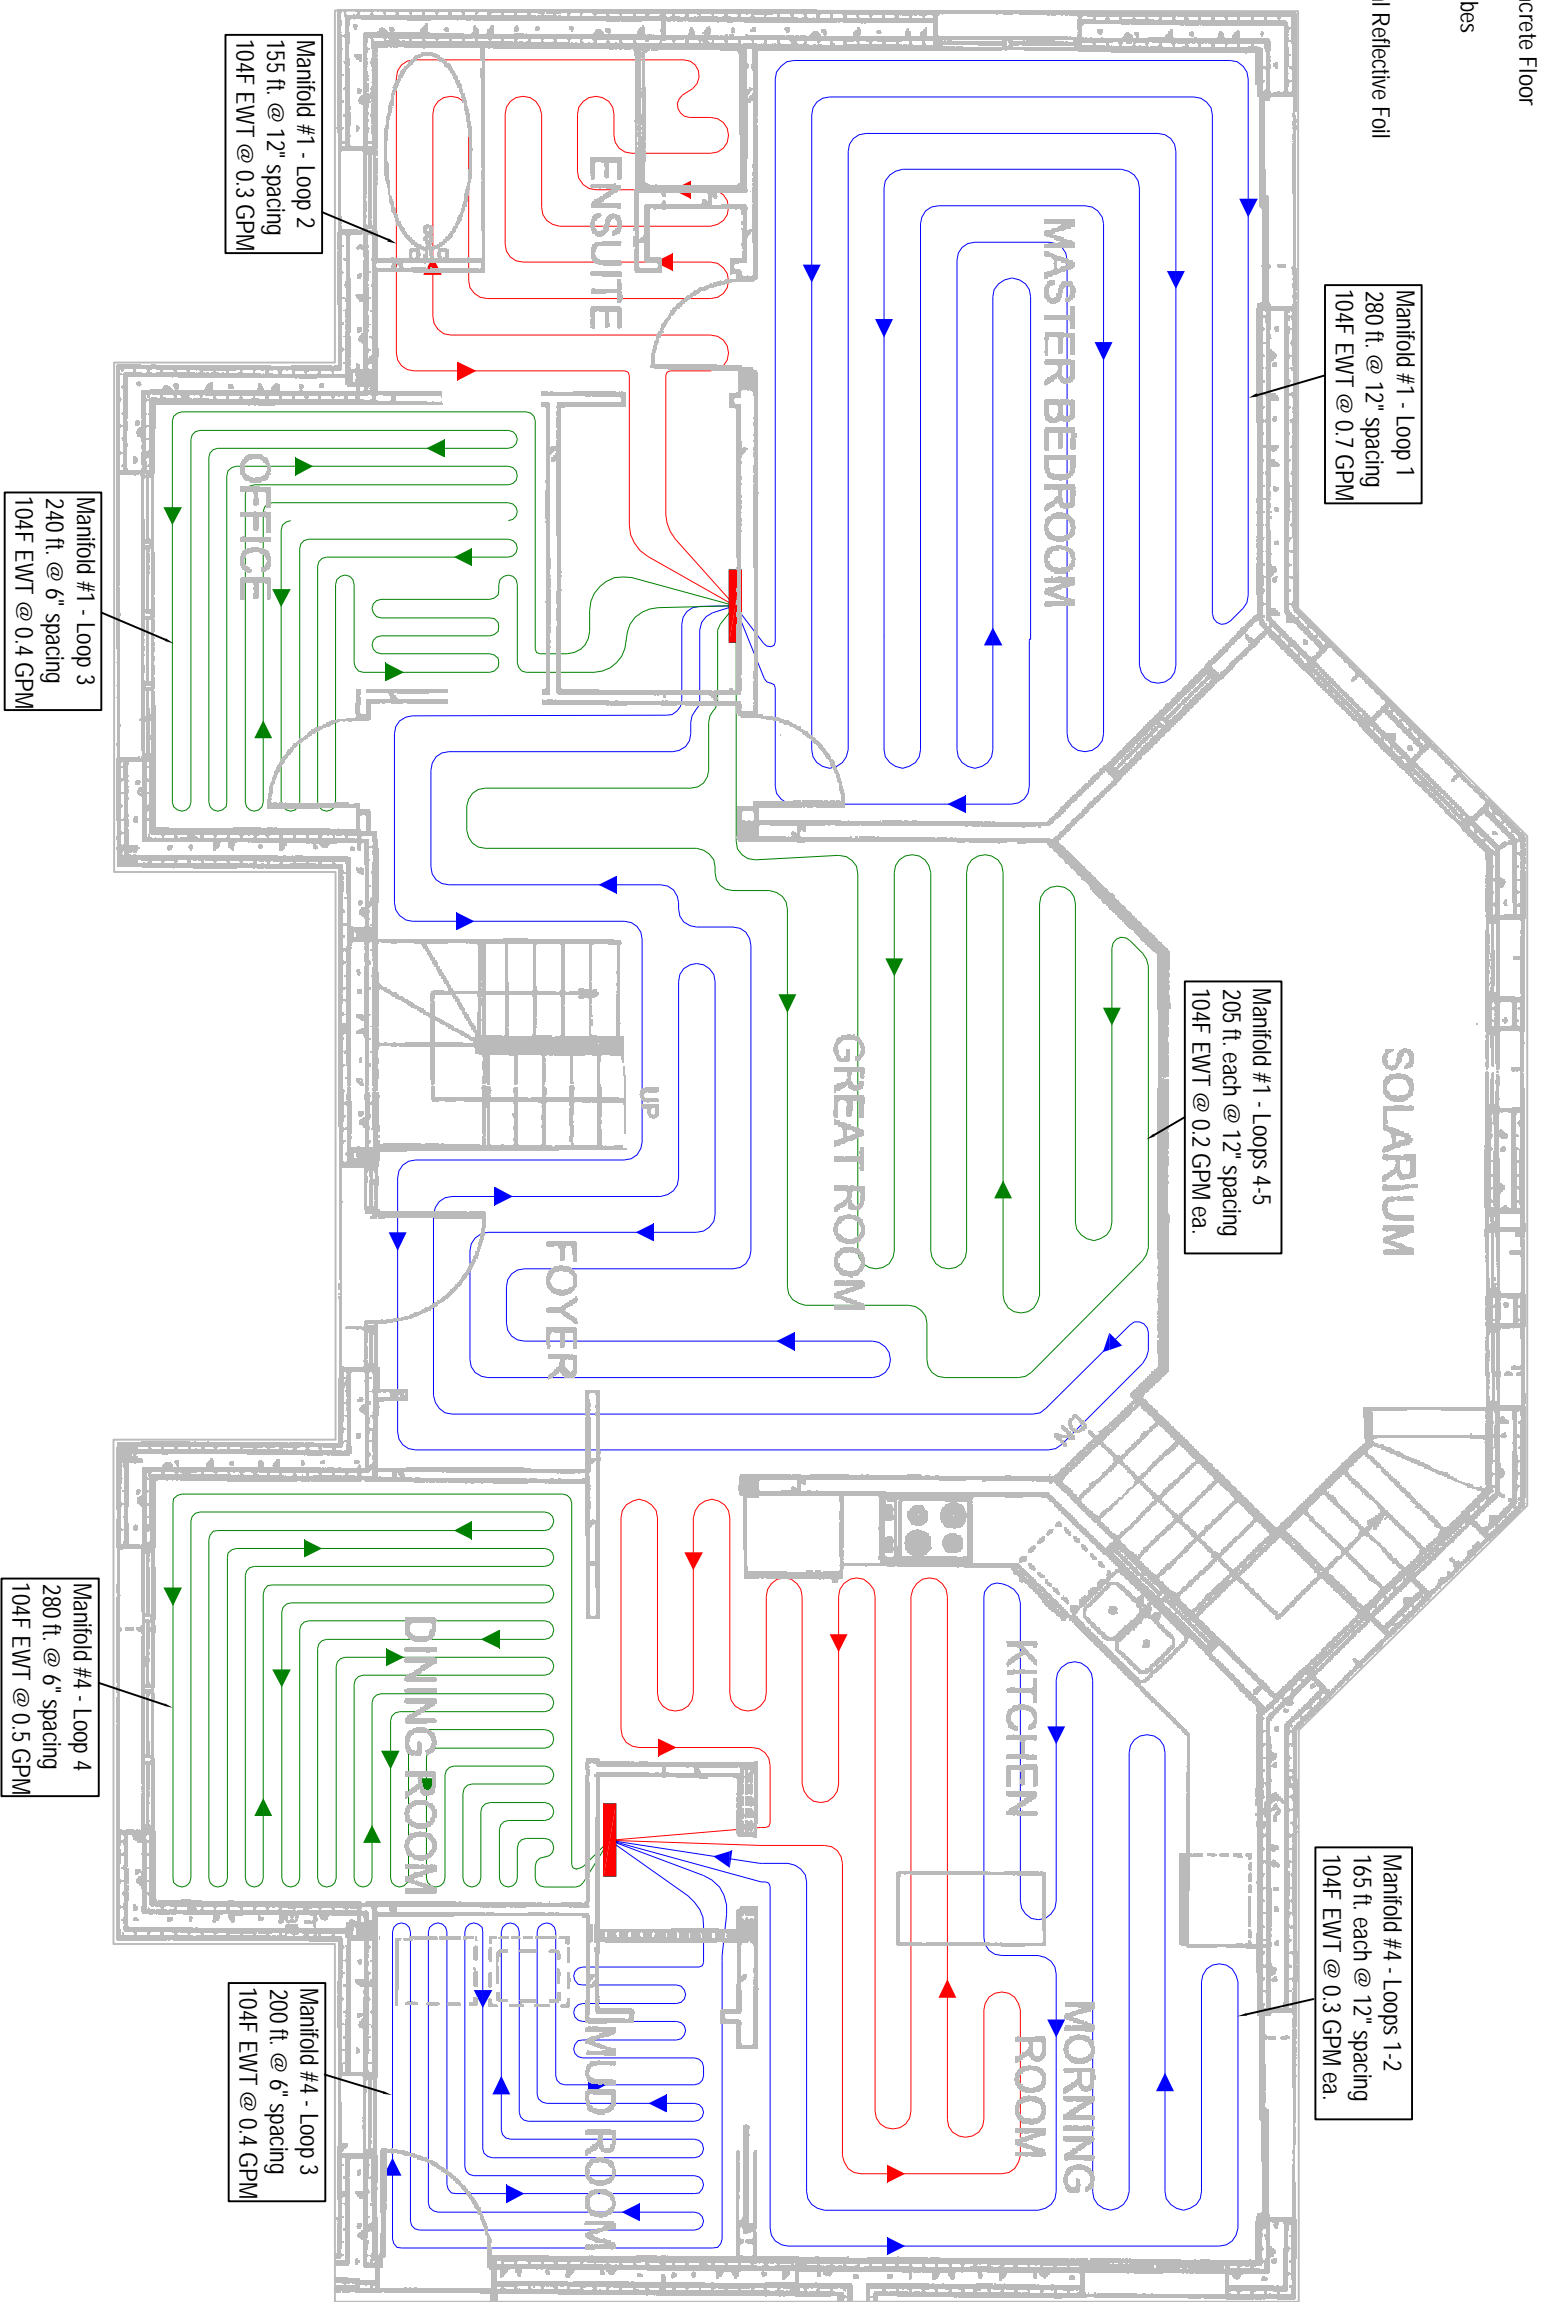

Manifold #1 - Loop 1
 280 ft. @ 12" spacing
 104F EWT @ 0.7 GPM

Manifold #1 - Loops 4-5
 205 ft. each @ 12" spacing
 104F EWT @ 0.2 GPM ea.

Manifold #4 - Loops 1-2
 165 ft. each @ 12" spacing
 104F EWT @ 0.3 GPM ea.

Manifold #1 - Loop 2
 155 ft. @ 12" spacing
 104F EWT @ 0.3 GPM

Manifold #1 - Loop 3
 240 ft. @ 6" spacing
 104F EWT @ 0.4 GPM

Manifold #4 - Loop 4
 280 ft. @ 6" spacing
 104F EWT @ 0.5 GPM

Manifold #4 - Loop 3
 200 ft. @ 6" spacing
 104F EWT @ 0.4 GPM

ENERLOSS
 INC.

HVACDesign

R.R. 1 Hartington ON
 613.374.5284
 enerloss@sympatico.ca

| | |
|-----------------------|---|
| project name | Sample |
| drawing name | Hydronic Radiant Heating |
| installing contractor | Sample |
| date (d/m/y) | 00/00/00 |
| plot scale | NTS |
| files | CAD - enerloss4/sample HCA - #100-sample |